


REV.	DESCRIPTION	DATE	APPROVED
-	-	-	-

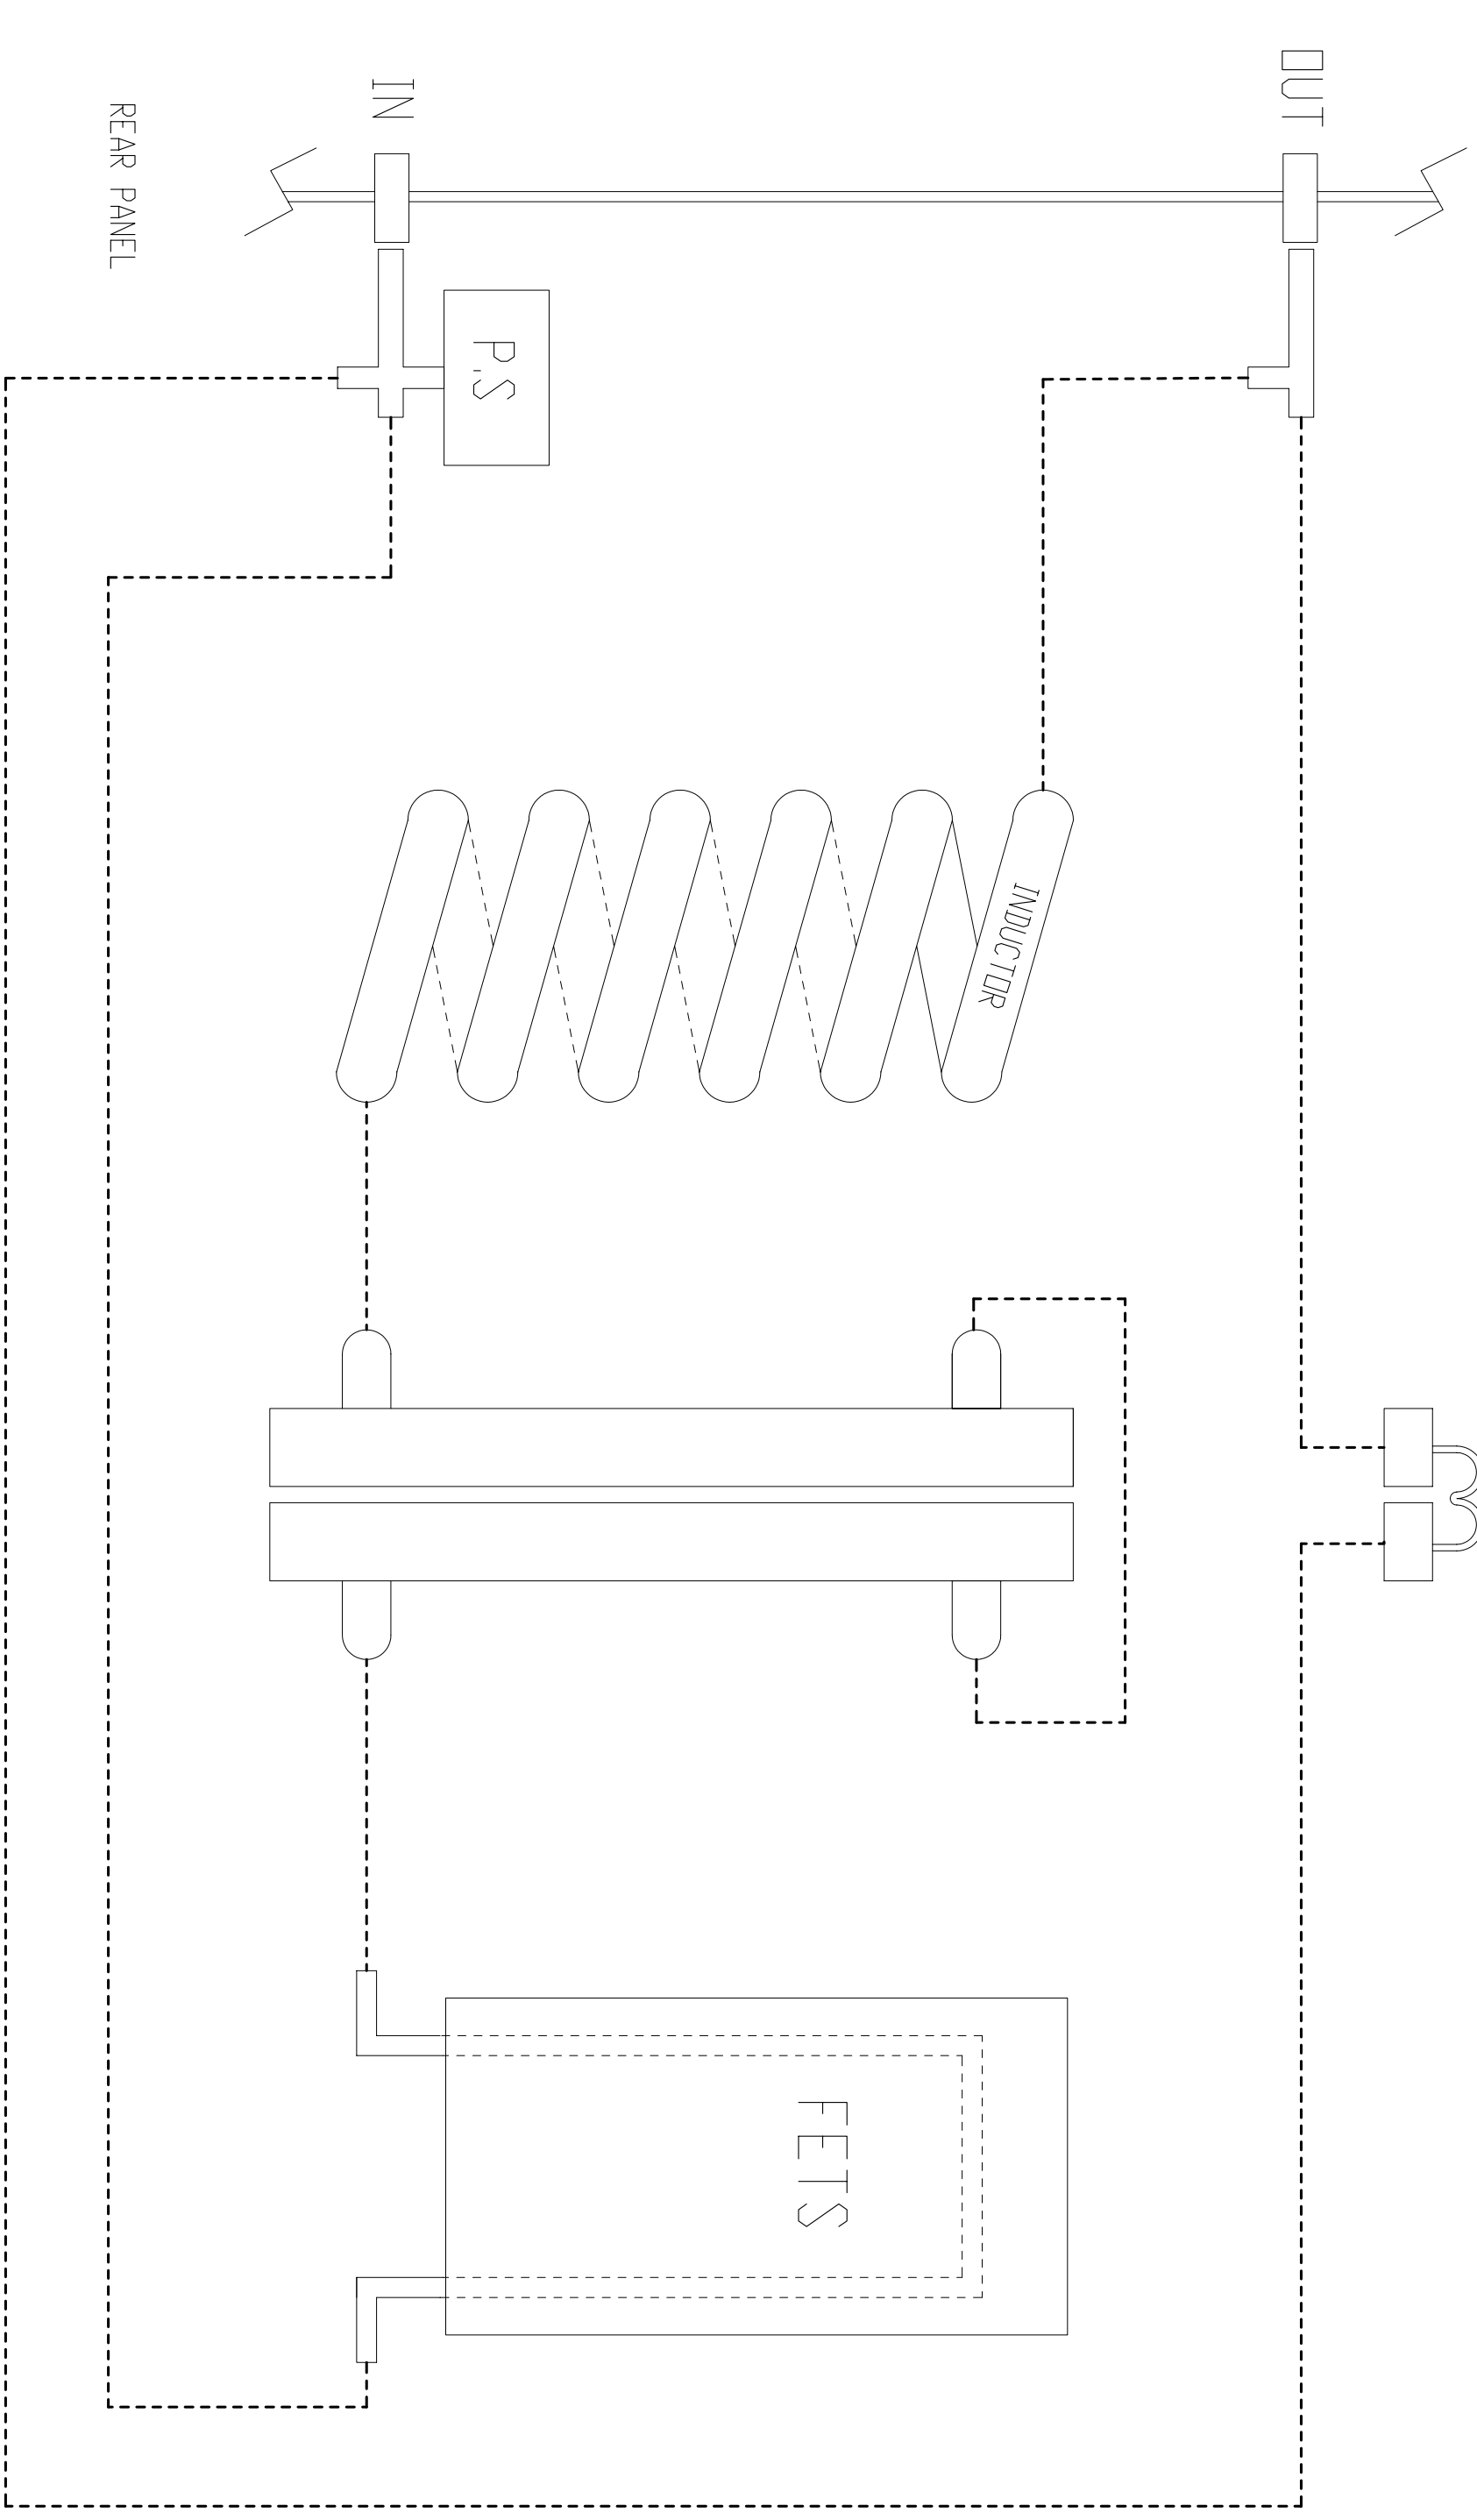

NOTES:

1. ALL WATER CONNECTIONS TO BE TESTED AT 100 P.S.I.
2. DO NOT USE METAL HOSE CLAMPS FOR SYSTEM ASSEMBLY
USE PLASTIC, NON-CONDUCTIVE CLAMPS.
3. ALL HOSES TO BE 3/8" I.D.

QUANTITY PER UNIT		SIZE		SHEET 1 OF 1		UNLESS OTHERWISE SPECIFIED TOLERANCES ARE IN INCHES		REVISION DESCRIPTION		WATER ROUTING DIAGRAM		DESIGNED BY		DATE		DWG. NO.	
-		-		-		XXX				3 kW UNIT		YANG		05.10.20		-	
CHECKED		ISSUED		SCALE		FINISH		REV. BY		REV. DATE		REV. No.					
-		-		NONE													
DO NOT SCALE DRAWING																	

Precision Power Systems & Technology, Inc.