


REV.	DESCRIPTION	DATE	APPROVED
A	NEW DESIGN MODIFICATIONS	3/31/99	HK.
B	PRODUCTION DESIGN CHANGES	10/25/99	HK.
C	CHANGES PER DR xxx	6/13/02	RL.
D	DESIGN CHANGES	5/13/06	

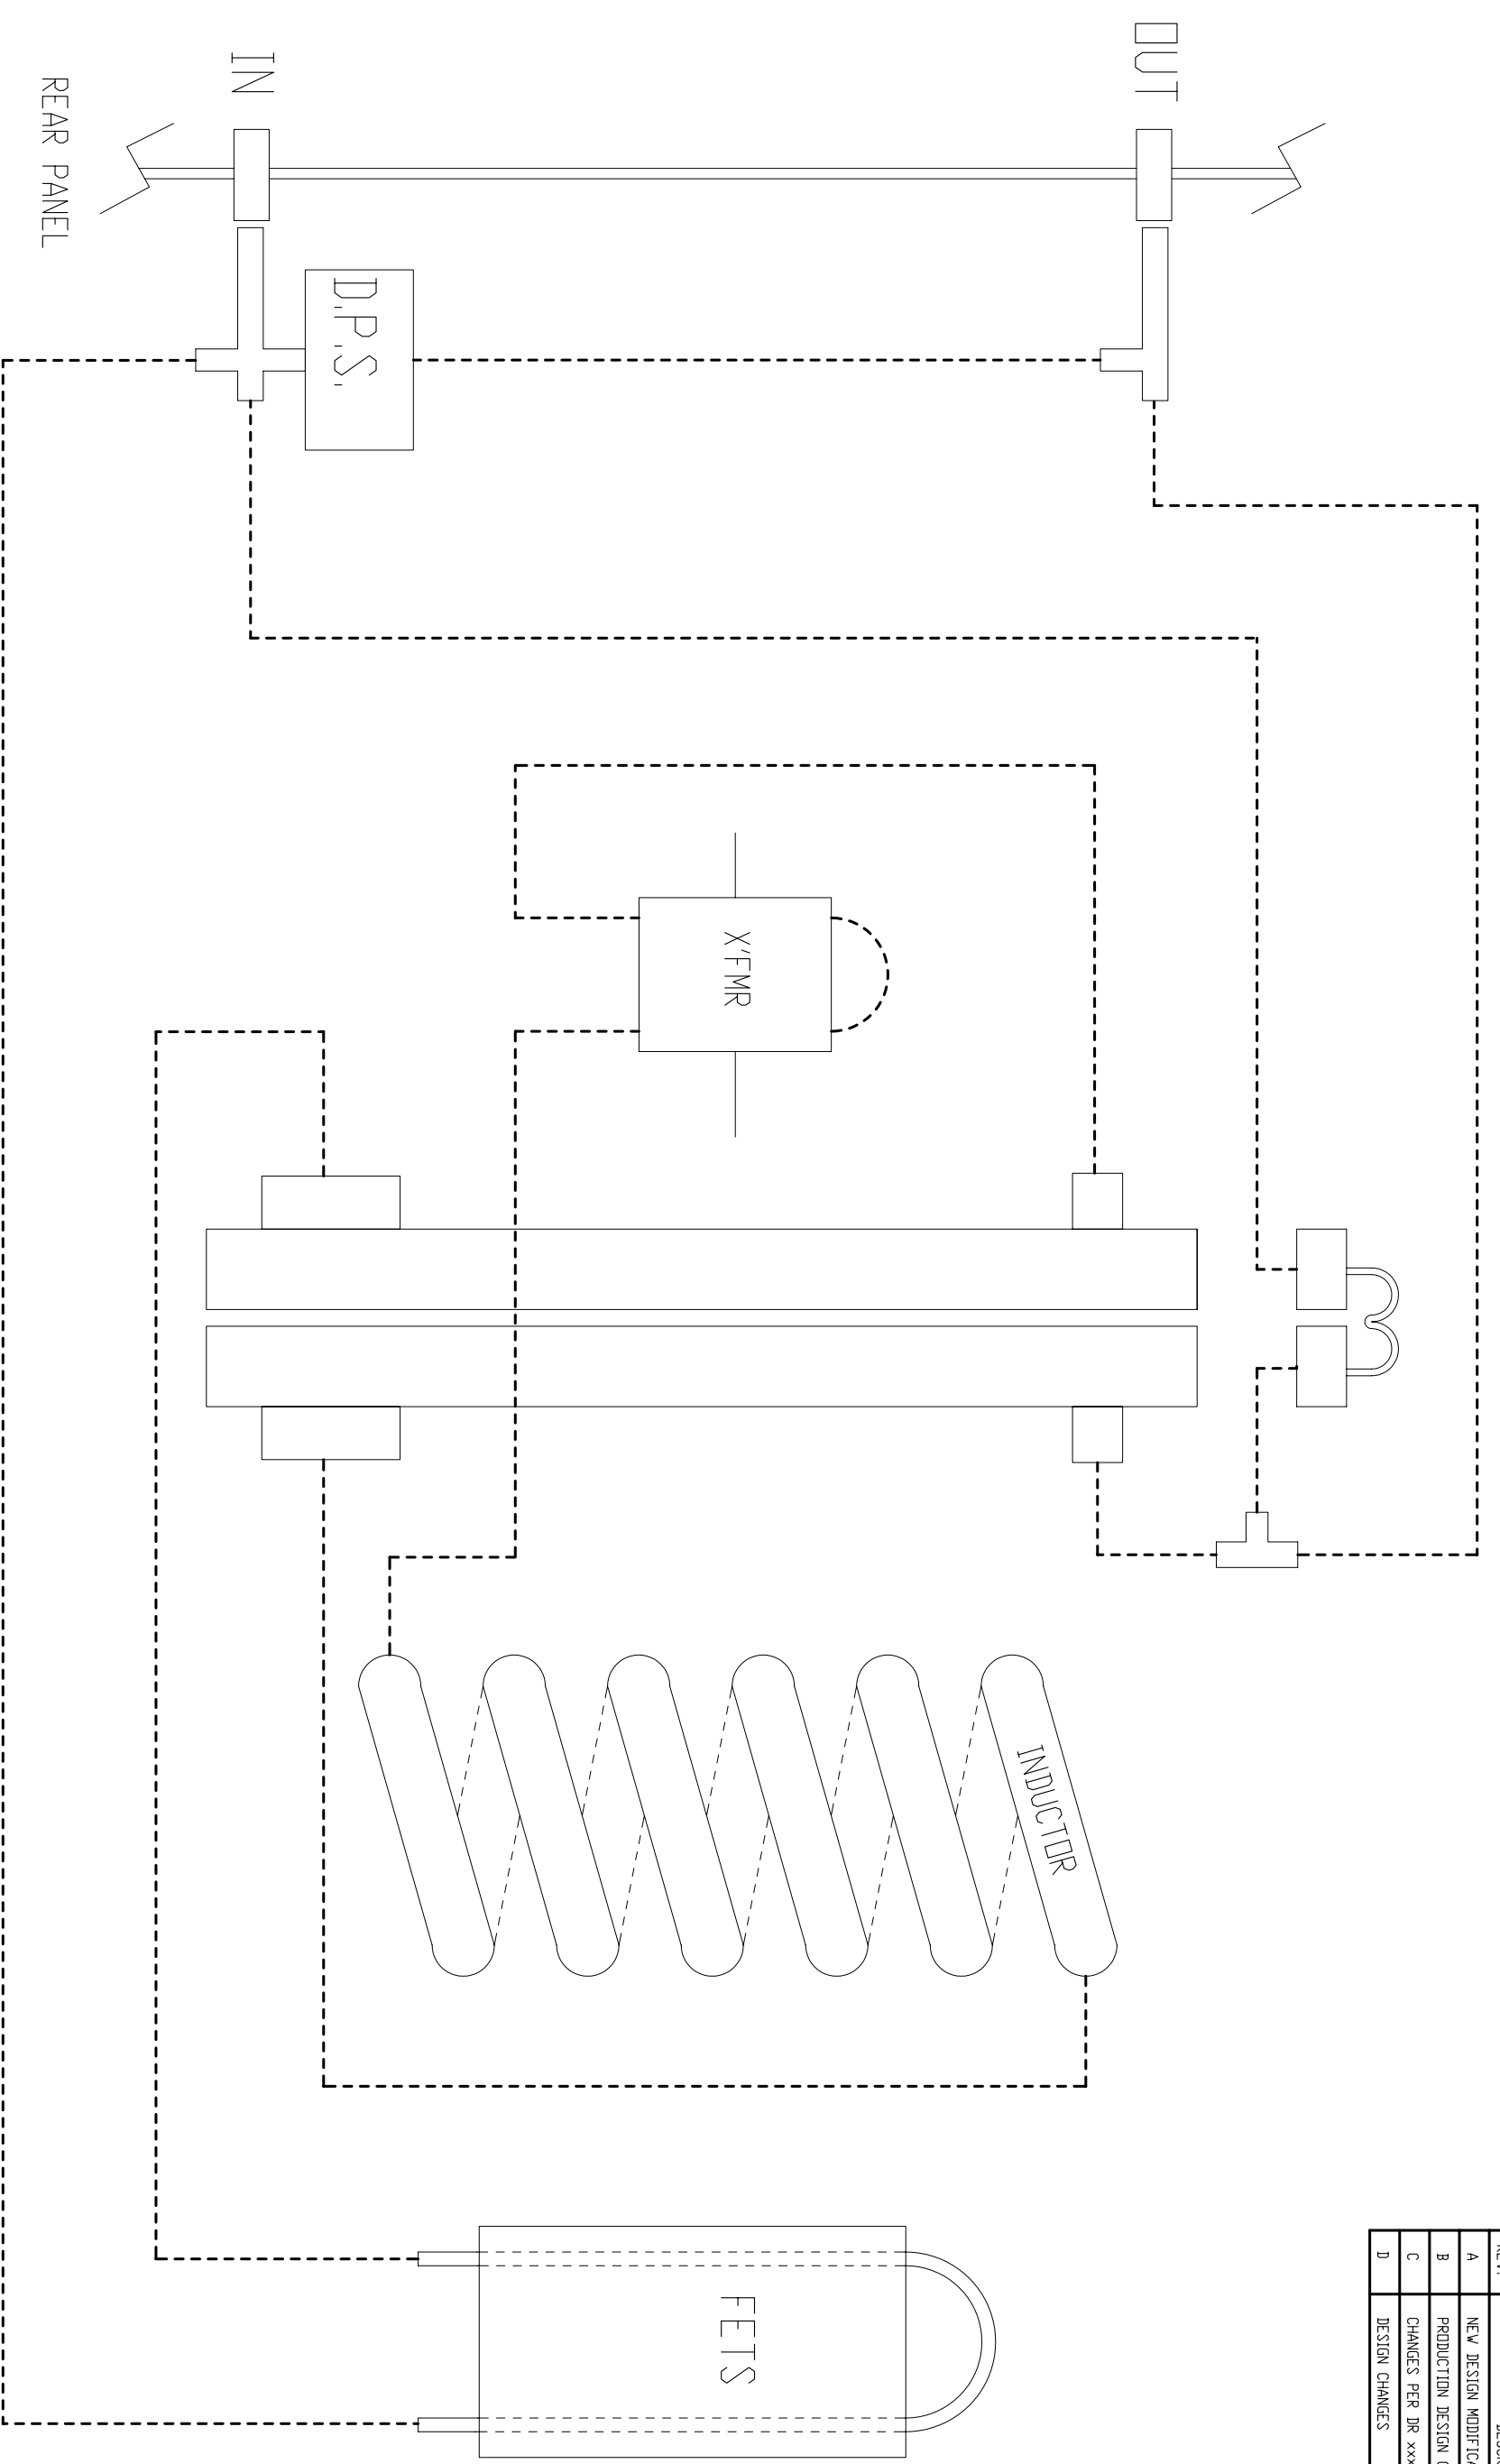

- NOTES:
1. ALL WATER CONNECTIONS TO BE TESTED AT 100 P.S.I.
 2. DO NOT USE METAL HOSE CLAMPS FOR SYSTEM ASSEMBLY
USE PLASTIC, NON-CONDUCTIVE CLAMPS.
 3. ALL HOSES TO BE 3/8" I.D.

QUANTITY PER UNIT		SIZE		SHEET 1 OF 1		UNLESS OTHERWISE SPECIFIED TOLERANCES ARE IN INCHES	
1		D		3/18/99		FRACTIONS DECIMALS ANGLES	
		ISSUED		H.K.		xxx	
		SCALE		NONE		MATERIAL	
		DO NOT SCALE DRAWING				FINISH	
REVISION DESCRIPTION				REV.	REV.	REV.	REV.
				BY	DATE	No.	
WATER ROUTING DIAGRAM				Precision Power Systems & Technology, Inc.			
5, 7.5 kW UNIT				DESIGN BY	DATE	DWG. NO.	
				D/SAIA	3/18/99	11110345	