


REV.	DESCRIPTION	DATE	APPROVED
A	-	-	-
B	NEW MODEL	06.11.24	-
C	MODS. COOLER	07.05.25	-

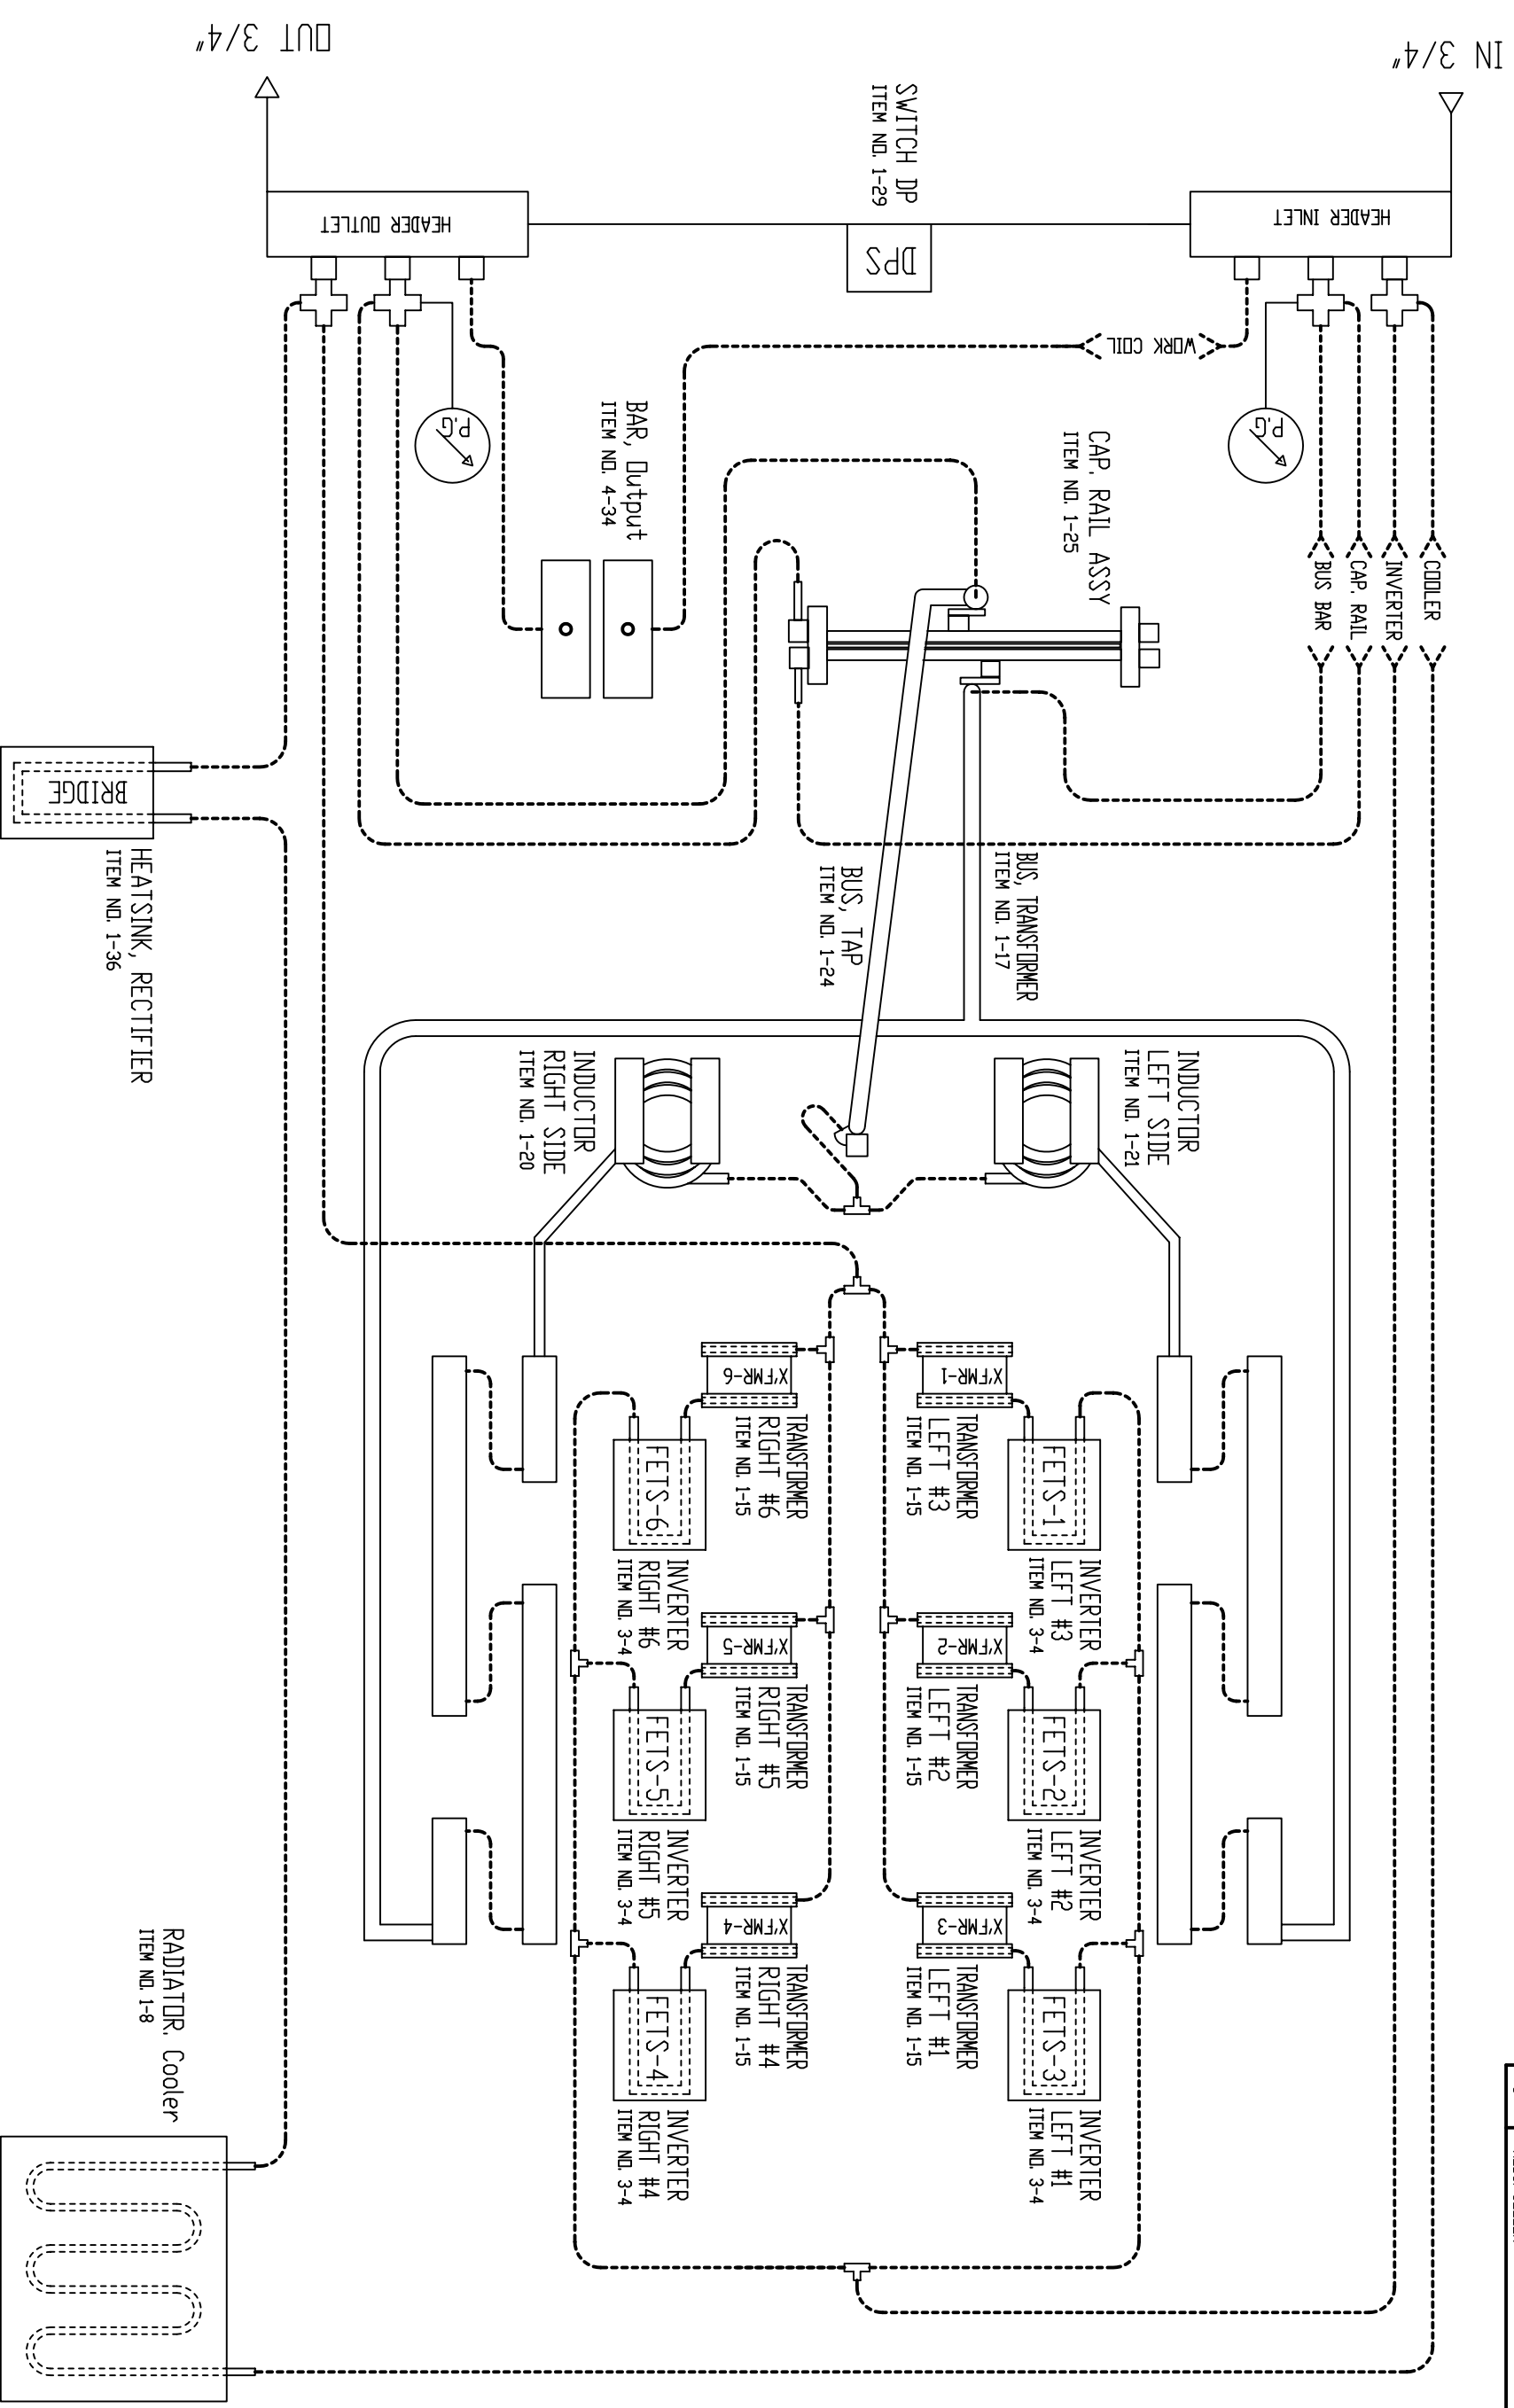

- NOTES:
1. ALL WATER CONNECTIONS TO BE TESTED AT 100 P.S.I.
  2. DO NOT USE METAL HOSE CLAMPS FOR SYSTEM ASSEMBLY USE PLASTIC, NON-CONDUCTIVE CLAMPS.
  3. ALL HOSES TO BE 3/8" I.D.

QUANTITY PER UNIT	SIZE	SHEET 1 OF 1	UNLESS OTHERWISE SPECIFIED	REVISION DESCRIPTION	WATER ROUTING DIAGRAM	120 KW UNIT	DESIGNED BY	DATE	DWG. NO.
1	-	-	FRACCTIONS DECIMALS ANGLES	C			YANG	06.05.15	-
	SCALE: NONE		DO NOT SCALE DRAWING						

Precision Power Systems & Technology, Inc.